


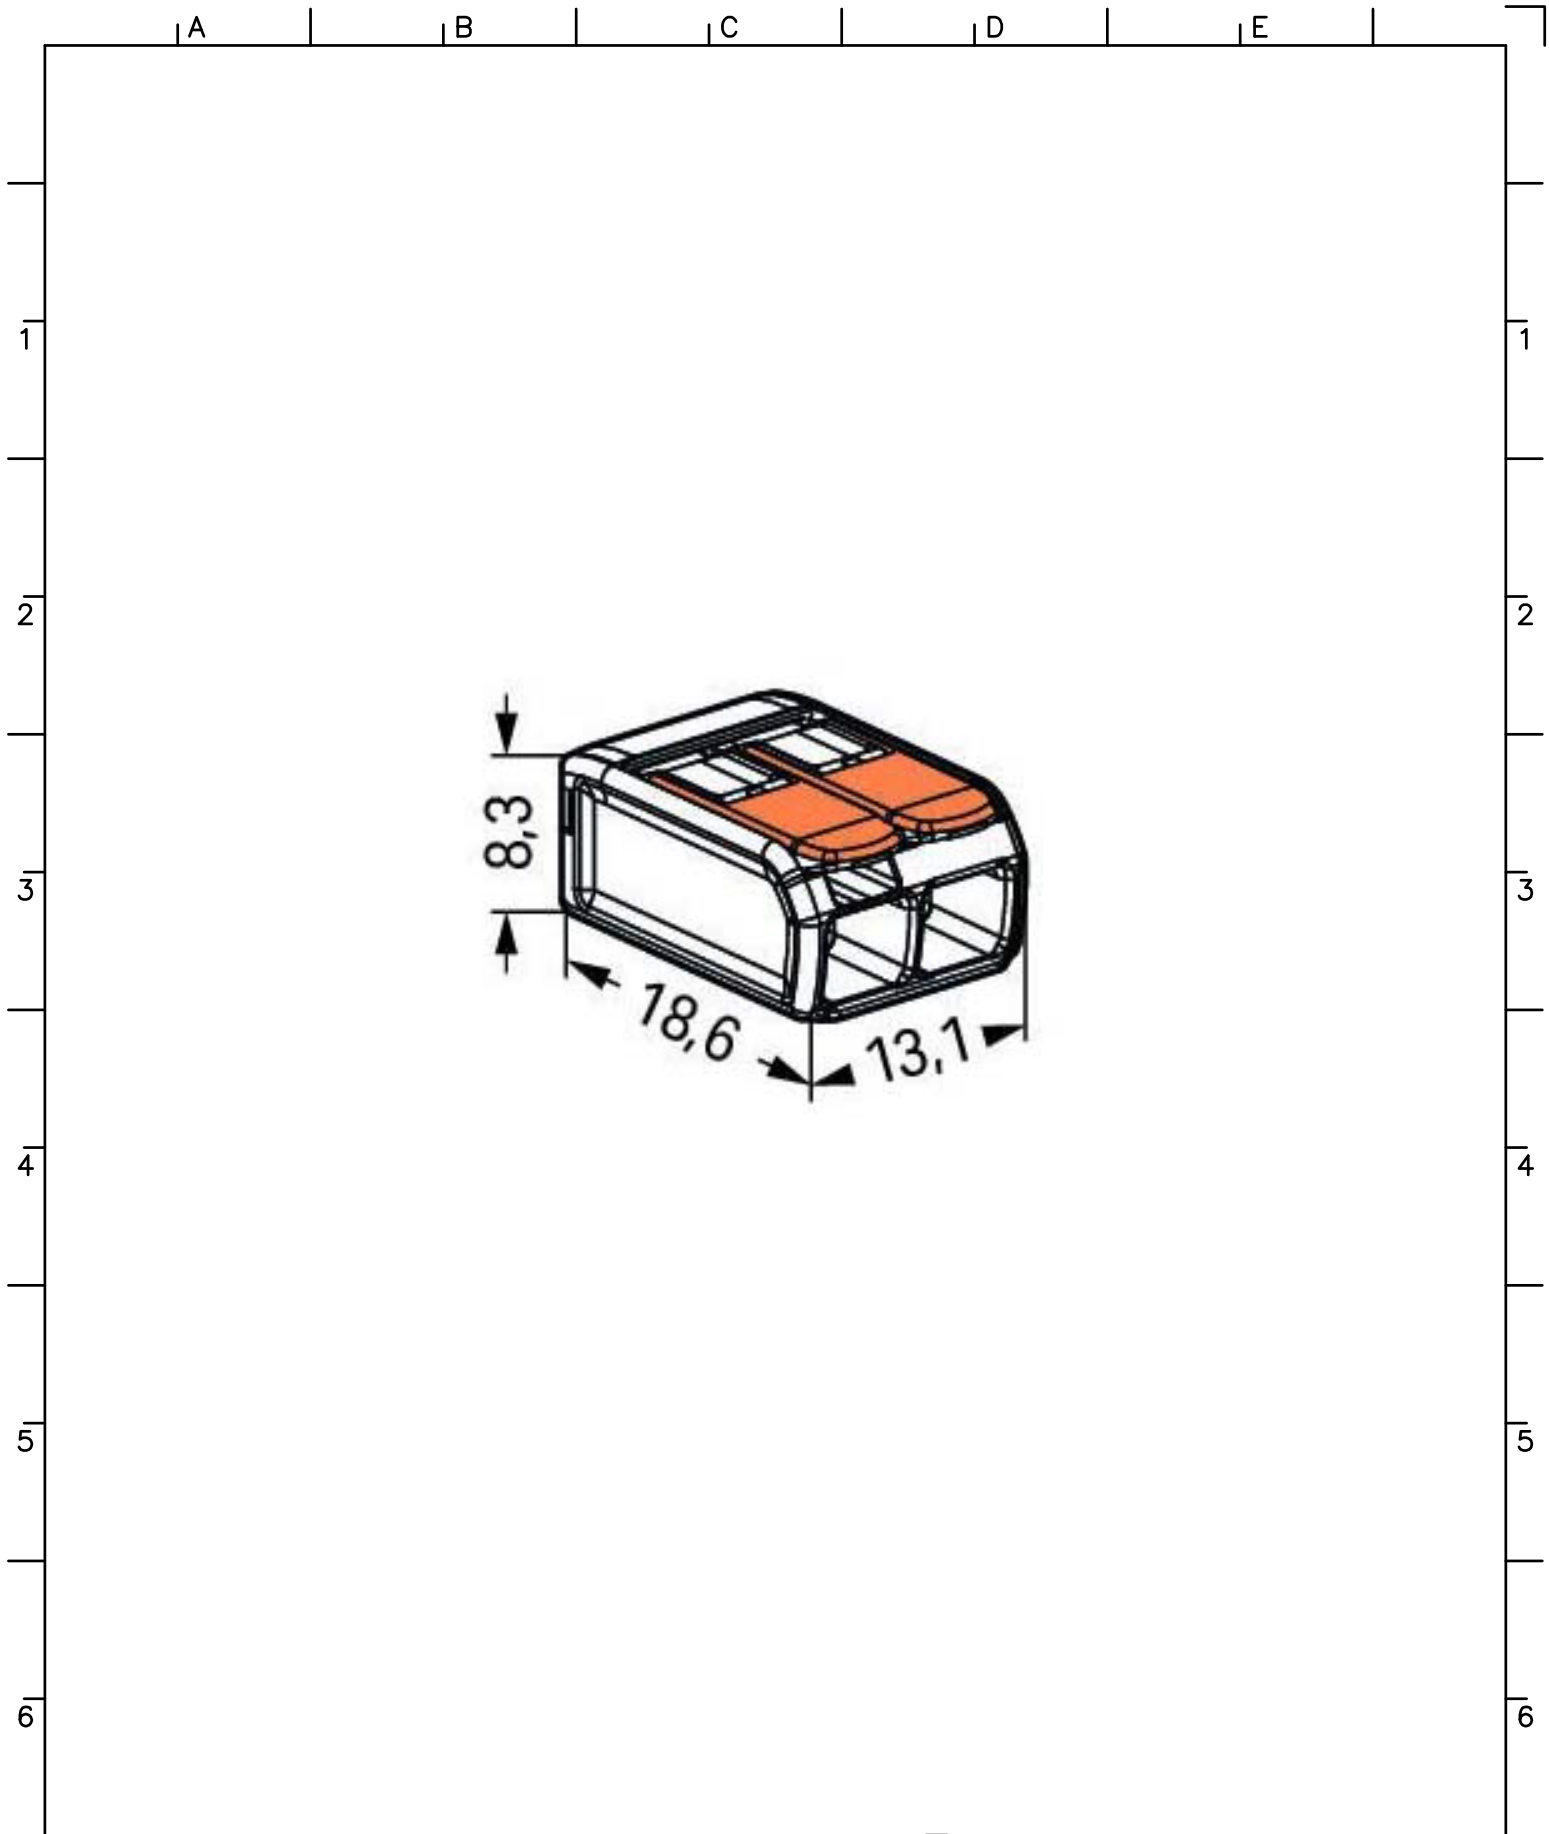

|                                              |                  |     |         |             |         |
|----------------------------------------------|------------------|-----|---------|-------------|---------|
| 大 廣 有 限 公 司 DA KOANG CO., LTD.               | DATE             | DWN | CHKD    | APVD        | MANAGER |
|                                              | 12.08.2005       |     |         |             |         |
| PART NAME: 2-CONDUCTOR TERMINAL BLOCK        | PART NUMBER:9304 |     |         | VERSION:2.0 |         |
| TOLERANCE :±0.3mm UNLESS OTHERWISE SPECIFIED |                  |     | UNIT:mm |             | SCALE:  |